


Quick Specification Guide



Integral Hood Ventless Fryers

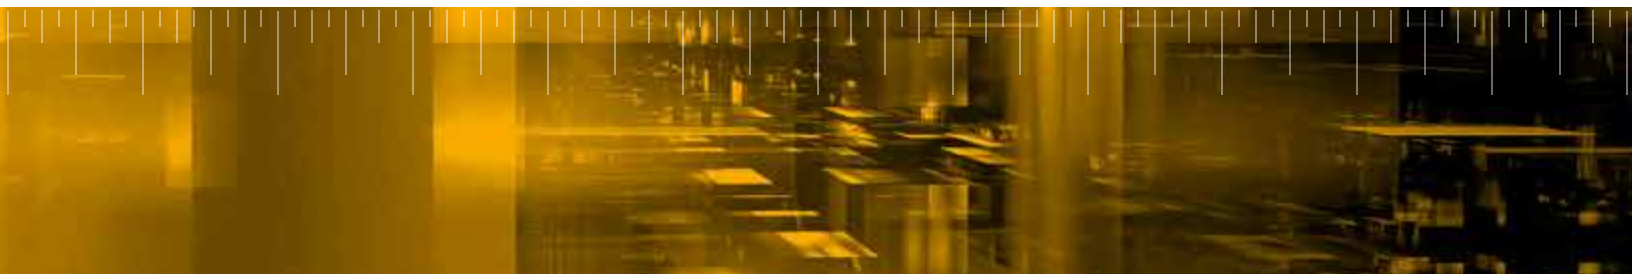


PROVEN & TRUSTED SINCE 1952

WOG-MP-VH



PROVEN & TRUSTED SINCE 1952

www.gfse.com

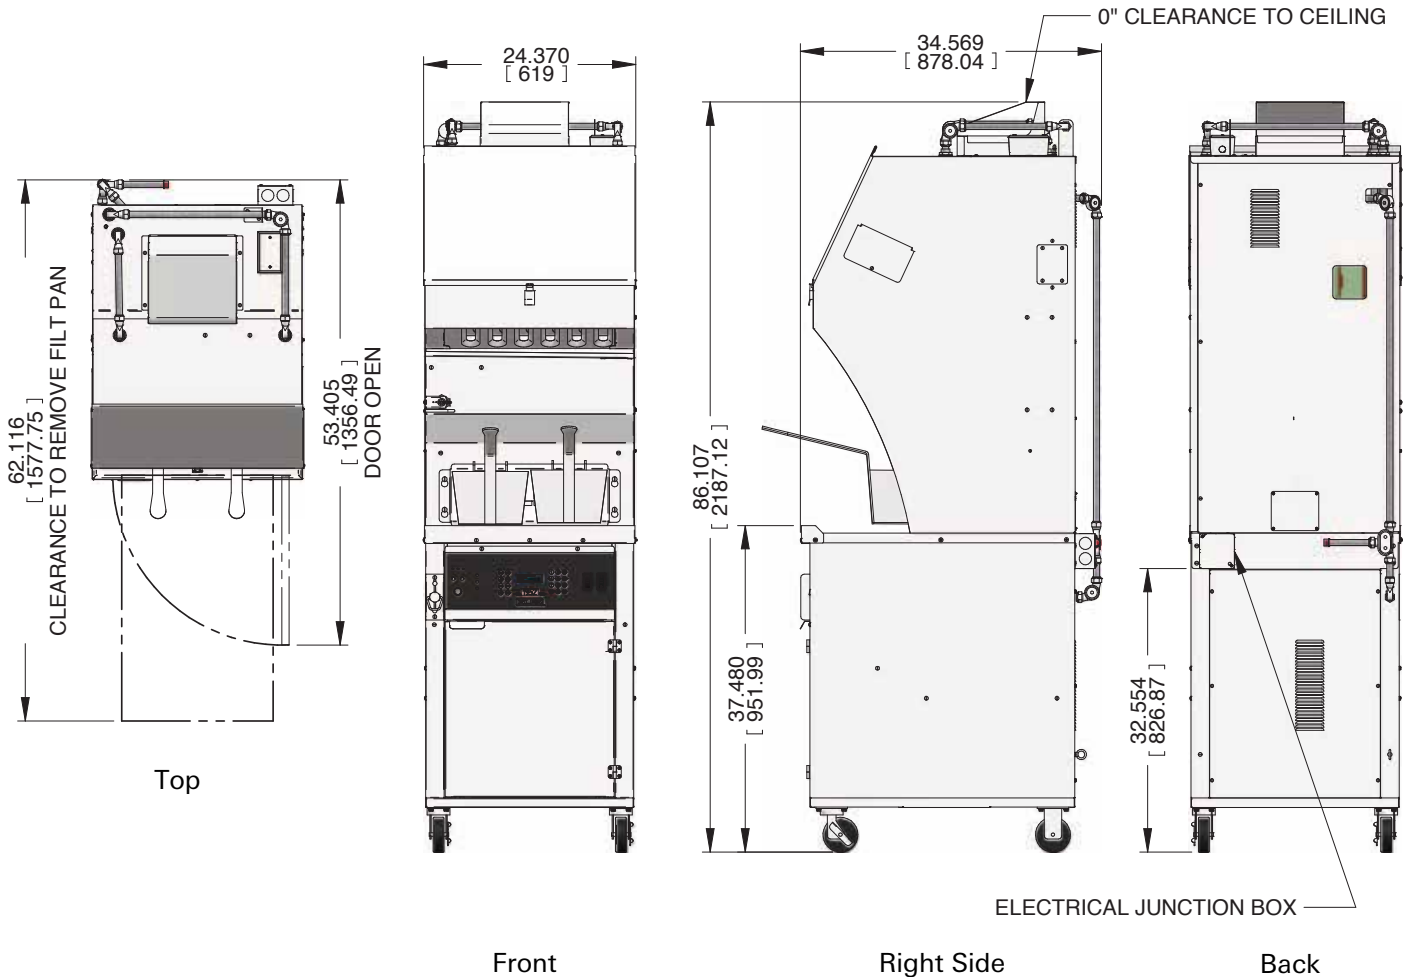


Inches [millimeters]

Installation Requirements	
Distance from ceiling (exhaust outlet)	Recommended, 0" (0 cm)
Distance from combustibles (sides)	Sides, 0" (0cm)
Distance from combustibles (Back & Top)	0" (0cm)
Mounting height above appliance	N/A
Minimum ceiling height	86" (218cm)
Fire Suppression System	Ansul R-102 Wet system Included ***

***FINAL INSTALLATION, CHARGING AND TESTING OF THE SYSTEM MUST BE PERFORMED BY AN AUTHORIZED ANSUL DISTRIBUTOR OR OTHER QUALIFIED FIRE PROTECTION AGENT.
THIS IS THE SOLE RESPONSIBILITY OF THE CUSTOMER AND IS NOT INCLUDED WITH THE FRYER PURCHASE.

GILES
PROVEN & TRUSTED SINCE 1952
www.gfse.com



Distance from ceiling (exhaust outlet)	Recommended, 0" (0 cm)
Distance from combustibles (sides)	Sides, 0" (0cm)
Distance from combustibles (Back & Top)	0" (0cm)
Mounting height above appliance	N/A
Minimum ceiling height	90" (228.6cm)
Fire Suppression System	Ansul R-102 Wet system Included ***


***FINAL INSTALLATION, CHARGING AND TESTING OF THE SYSTEM MUST BE PERFORMED BY AN AUTHORIZED ANSUL DISTRIBUTOR OR OTHER QUALIFIED FIRE PROTECTION AGENT.
THIS IS THE SOLE RESPONSIBILITY OF THE CUSTOMER AND IS NOT INCLUDED WITH THE FRYER PURCHASE.

GEF-400-VH



PROVEN & TRUSTED SINCE 1952

www.gfse.com

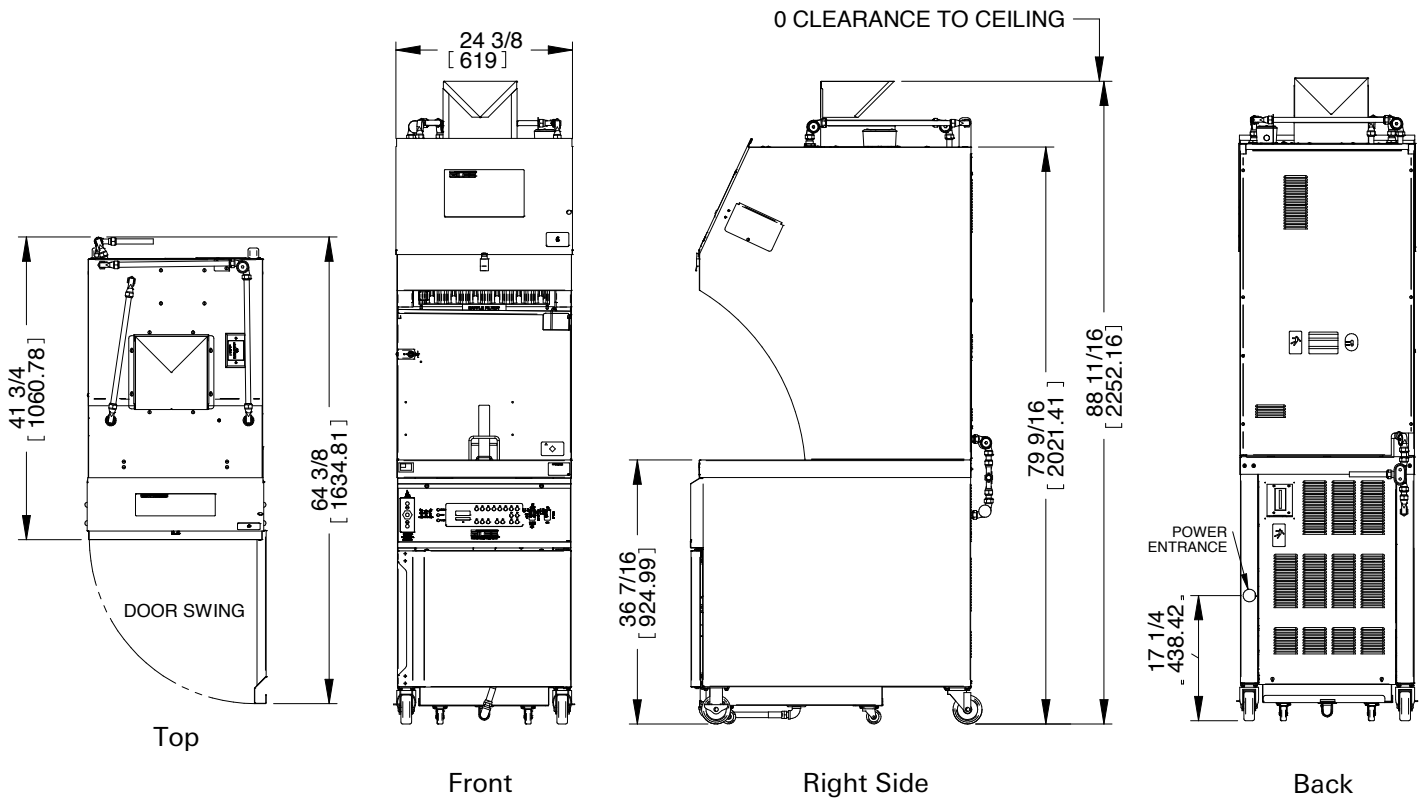


Inches [millimeters]

Installation Requirements

Distance from ceiling (exhaust outlet)	Recommended, 0" (0 cm)
Distance from combustibles (sides)	Sides, 0" (0cm)
Distance from combustibles (Back & Top)	0" (0cm)
Mounting height above appliance	N/A
Minimum ceiling height	90" (228.6cm)
Fire Suppression System	Ansul R-102 Wet system Included ***

***FINAL INSTALLATION, CHARGING AND TESTING OF THE SYSTEM MUST BE PERFORMED BY AN AUTHORIZED ANSUL DISTRIBUTOR OR OTHER QUALIFIED FIRE PROTECTION AGENT.
THIS IS THE SOLE RESPONSIBILITY OF THE CUSTOMER AND IS NOT INCLUDED WITH THE FRYER PURCHASE.


GEF-560-VH

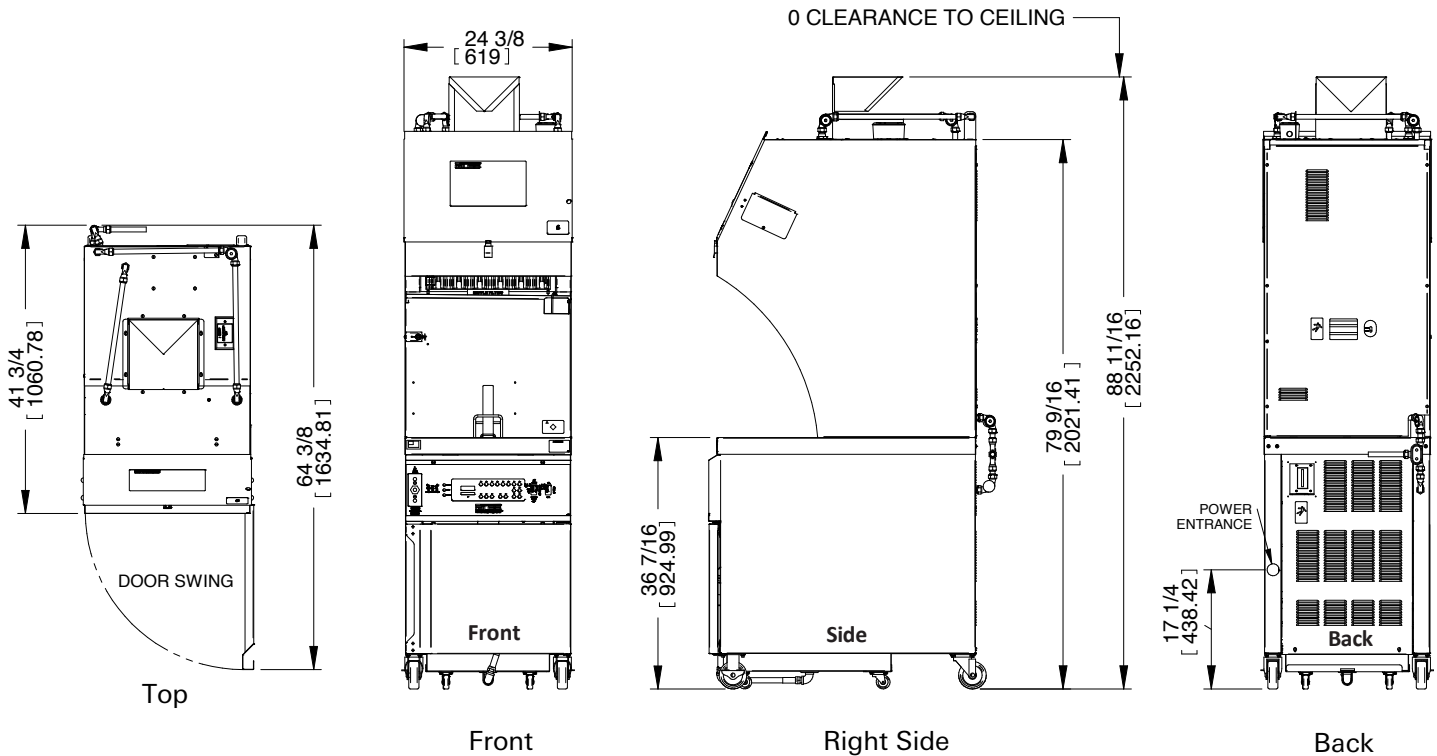

Inches [millimeters]

Installation Requirements	
Distance from ceiling (exhaust outlet)	Recommended, 0" (0 cm)
Distance from combustibles (sides)	Sides, 0" (0cm)
Distance from combustibles (Back & Top)	0" (0cm)
Mounting height above appliance	N/A
Minimum ceiling height	90" (228.6cm)
Fire Suppression System	Ansul R-102 Wet system Included ***

***FINAL INSTALLATION, CHARGING AND TESTING OF THE SYSTEM MUST BE PERFORMED BY AN AUTHORIZED ANSUL DISTRIBUTOR OR OTHER QUALIFIED FIRE PROTECTION AGENT.
THIS IS THE SOLE RESPONSIBILITY OF THE CUSTOMER AND IS NOT INCLUDED WITH THE FRYER PURCHASE.

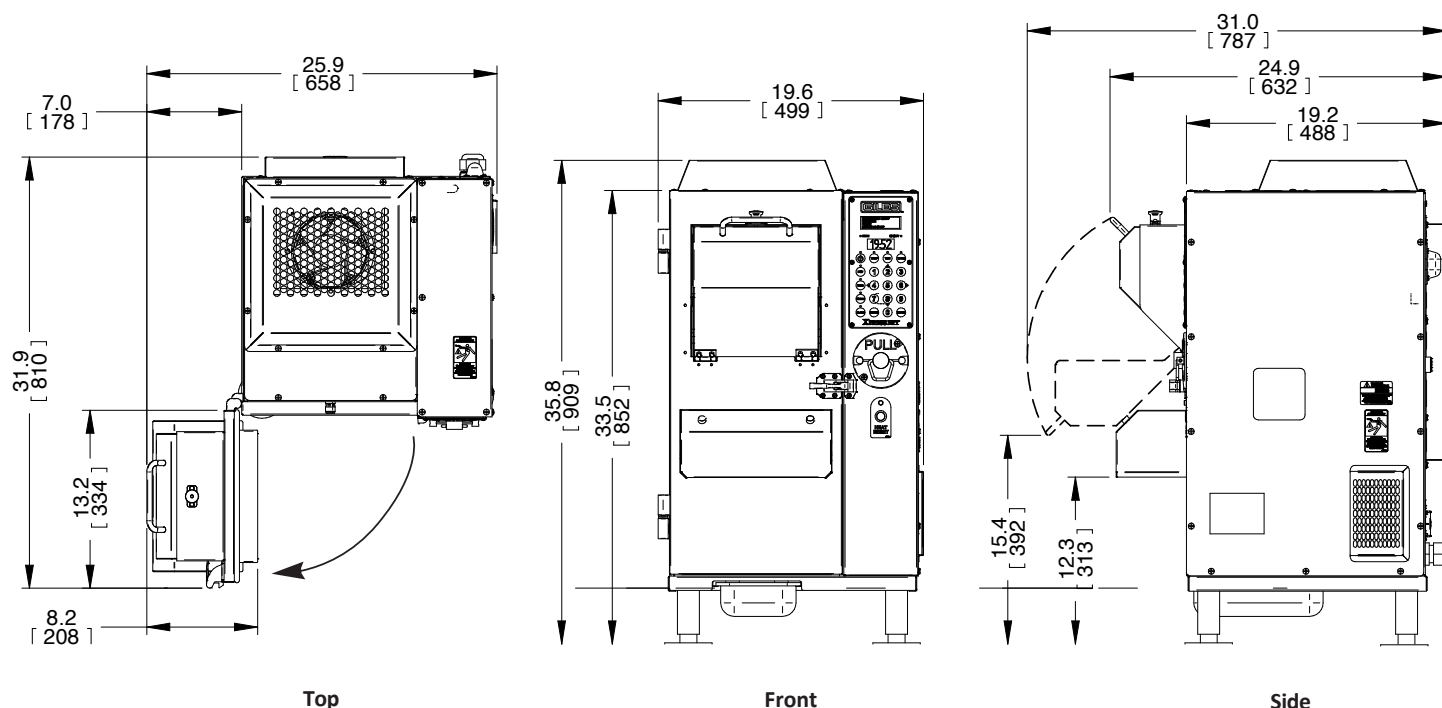

Inches [millimeters]

Installation Requirements	
Distance from ceiling (exhaust outlet)	Recommended, 0" (0 cm)
Distance from combustibles (sides)	Sides, 0" (0cm)
Distance from combustibles (back)	0" (0cm)
Distance from combustibles (top)	8" (203.2 mm)
Minimum ceiling height	90" (228.6cm)
Fire Suppression System	Self-contained fire extinguishing system with high-volume tank for added measure of safety.

Giles Food Service Equipment

ISO 9001 Registered Company

2750 Gunter Park Drive West • Montgomery, AL 36109 USA

Phone 334.272.1457 • Fax 334.239.4117 • Toll Free 800.554.4537

www.gfse.com

Email: services@gfse.com

Learn more at
www.gfse.com

